

Data sheet

SP044xxVBNN ASP044

Page 1/5

P/N

ASP0440822xx

xx=number of poles


2026/02/10

Version: C

Illustrations



Dimensional drawing as an example

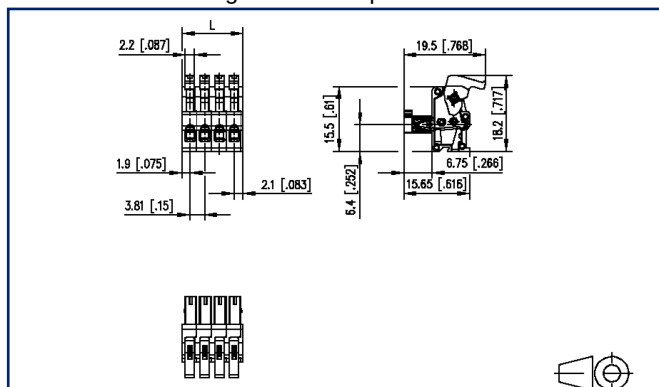

See enlarged drawings at the end of document

Product specification

- spring clamp terminal block, pluggable
- centerline 3.81 mm, direction of connection vertical 0°
- color black
- eccentric lever, wire entry uncodeable side parallel to plug direction



Data sheet

SP044xxVBNN ASP044

Page 2/5

P/N

ASP0440822xx

xx=number of poles

2026/02/10

Version: C

Technical Data

General Data

pole size	8		
Insulating material class	CTI 400		
clearance/creepage dist.	2.6 mm		
Protection category	IP20		
Insul. strip length	6 mm		
Rated current	10 A		
Overvoltage category	III	III	II
Pollution degree	3	2	2
Rated voltage	32 V	200 V	200 V
Rated test voltage	2.5 kV	2.5 kV	2.5 kV

Terminal data

rat.wiring solid AWGmax	0.08 mm ² - 1.5 mm ² / AWG 28 - AWG 16
rat.wiring strand.AWGmax	0.08 mm ² - 1.5 mm ² / AWG 28 - AWG 16

Approvals

 V / A	150 / 10
approval UL - File No.	E121004
	130 V / 2.5 kV / 10 A

Material

insulating material	PA46
flammability class	V0
spring material	Spring steel
contact material	CuSn
Contact surface	Sn
Glow-Wire Flammability GWFI	850 °C acc. to IEC 60695-2-12
Glow-Wire Flammability GWIT	775 °C acc. to IEC 60695-2-13

Climatic Data

upper limit temperature	105 °C
lower limit temperature	-40 °C

general

Tolerance	ISO 2768 -mH
-----------	--------------

Data sheet

Page 3/5

SP044xxVBNN ASP044

P/N

ASP0440822xx**xx=number of poles**

2026/02/10

Version: C

Technical Data

Application note

This product is a standard product of METZ CONNECT. METZ CONNECT is not aware of the specific intended use of the goods by the Customer or any customers of the Customer. The Customer guarantees that it has fully and sufficiently tested the use of the goods and any product modifications, product changes or product enhancements with regard to the specific intended use in accordance with the state of the art or in any other way. At METZ CONNECT's request, the Customer shall submit and make available meaningful evidence (e.g. test and laboratory protocols, certifications, etc.).



Data sheet

Page 4/5

SP044xxVBNN ASP044

P/N

ASP0440822xx

xx=number of poles

2026/02/10

Version: C

Counterpart

P/N	Designation
311901	PR044xxHBBN Type 190
311911	PR044xxVBNN Type 191
313821	PT094xxHBBN Type 382
313831	PT094xxVBNN Type 383



Data sheet

SP044xxVBNN ASP044

Page 5/5

P/N

ASP0440822xx


xx=number of poles

2026/02/10

Version: C

Illustrations

Dimensional drawing as an example

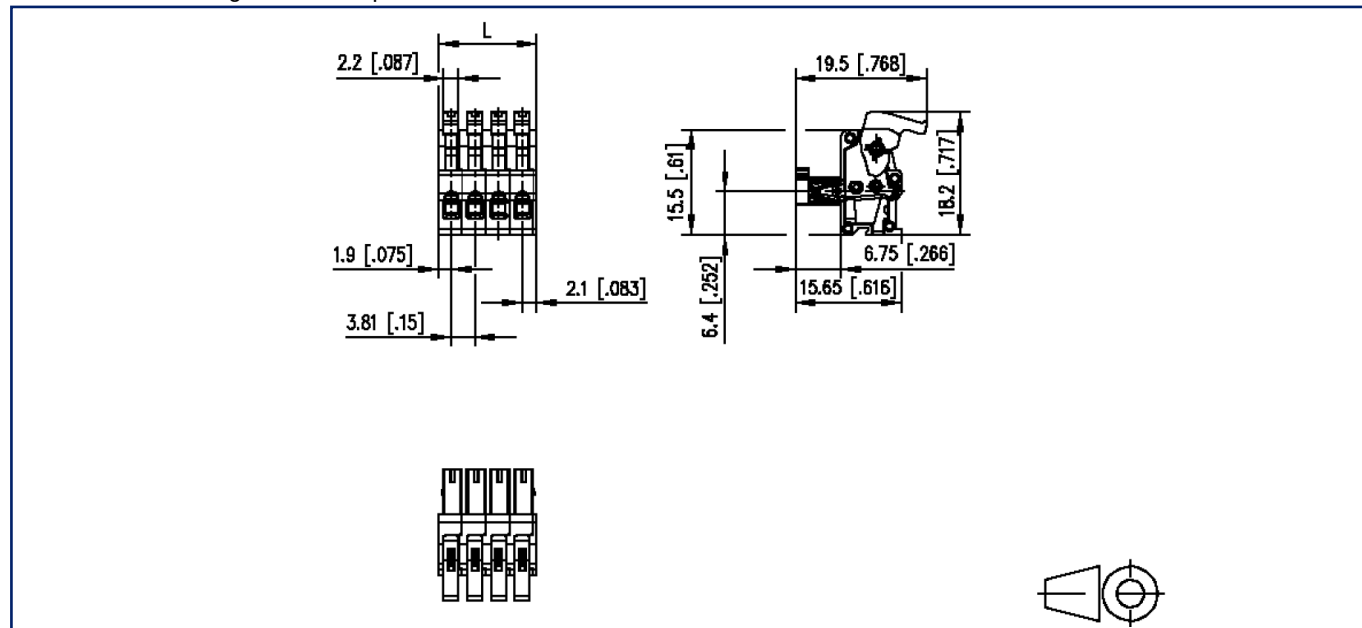

$L = (\text{pole size} - 1) \times \text{centerline} + 4 \text{ mm} [0.157]$